


01 SECOND FLOOR FINISH PLAN

SCALE: 1/8" = 1'-0"

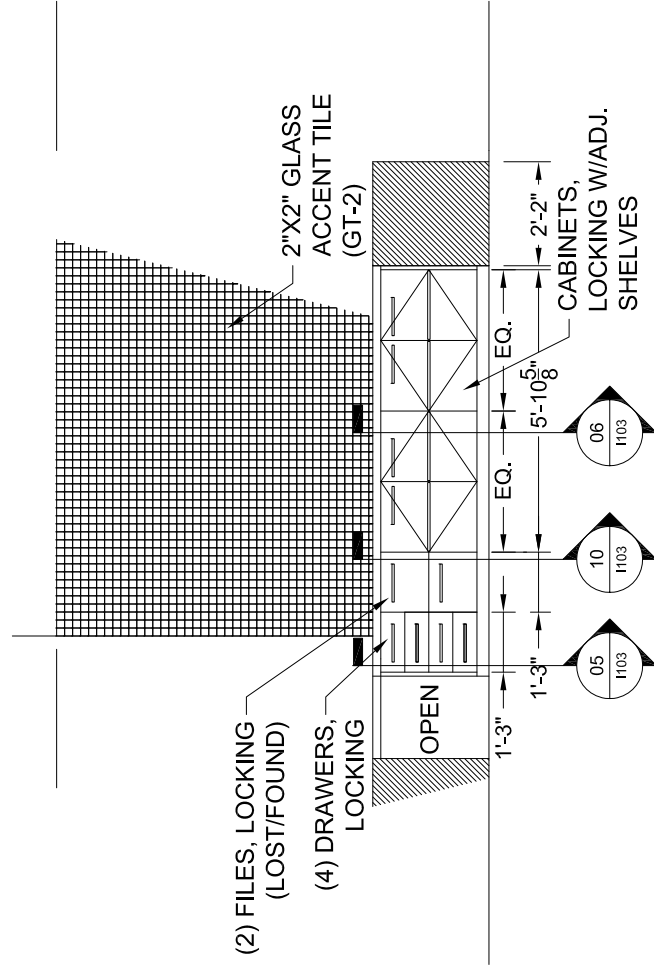

10 INFORMATION DESK CASEWORK

SCALE: 1/4" = 1'-0"

ADDENDUM #1 SKETCH ADD1-M1

REFERENCE DRAWING M-601

MARCH 16, 2011

FAN COIL UNIT SCHEDULE (2-PIPE)

MARK	LOCATION	CONFIGURATION	SUPPLY FAN DATA						HYDRONIC HEATING COIL CAPACITY DATA										HYDRONIC COOLING COIL CAPACITY DATA						FILTER DATA		SPECIFICATION SECTION	MANUFACTURER WITH MODEL NUMBER	NOTES					
			SUPPLY CFM	ESP	RPM	HP	VOLTS	PH	MIN MBH	EAT	LAT	ROWS	FINS/ INCH	EWT	GPM	MAX WPD	MIN. MBH	EAT		LAT		ROWS	FINS/ INCH	EWT	LWT	GPM				MAX WPD	TYPE	MERV RATING	UNIT WEIGHT (LBS)	
FCU-204-1	GATHERING AREA 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-2	GATHERING AREA 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-3	GATHERING AREA 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-4	REF. CONSULT. 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-5	REF. CONSULT. 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-6	REF. CONSULT. 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-7	GATHERING AREA 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-8	GATHERING AREA 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-9	PRINT COLLECTION 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-10	PRINT COLLECTION 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-11	PRINT COLLECTION 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-12	REF. CONSULT. 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-13	REF. CONSULT. 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-14	REF. CONSULT. 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-15	GATHERING AREA 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-204-16	GATHERING AREA 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-202-1	CONFERENCE ROOM 204	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-203-1	COLLABORATIVE STAFF OFFICE 203	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-203-2	COLLABORATIVE STAFF OFFICE 203	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-203-3	COLLABORATIVE STAFF OFFICE 203	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-333-1	WORK AREA 331	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5
FCU-333-2	WORK AREA 331	VERTICAL RECESSED	250	0.2	1088	1/8	115	1	11.7	70	112	4	12	125	1.0	4.5	6.0	4.76	77	66	58.8	55	4	12	45	57.1	1.0	5.0	PLEATED	7	71	238200	TRANE MODEL FCHB03	1, 2, 3, 4, 5

NOTES:

1. MAXIMUM WIDTH OF OPENING FOR INSTALLATION NOT TO EXCEED 3'-6".
2. PROVIDE CUSTOM STAMPED FRONT PANEL WITH RETURN OPENINGS. PROVIDE DUCT COLLAR FOR TOP DISCHARGE AND EXTEND A DUCT TO THE EXISTING GRILLE IN SILL.
3. SAME END CONNECTIONS. VERIFY IN FIELD.
4. PROVIDE MANUFACTURER'S DISCONNECT SWITCH.
5. HIGH STATIC ECM MOTOR.