

ADDENDUM NO. 3 - SEPTEMBER 8, 2011


West Lafayette Campus
BIOCHEMISTRY BUILDING ROOMS 319 & 320 RENOVATION - 2011
Purdue University
West Lafayette, Indiana

Project ID: 11410
Building Index NO: B-1

SCHOLER CORPORATION
111 Walter Scholer Drive
LAFAYETTE, INDIANA

COMM. NO. 2010.27

THE FOLLOWING CHANGES AND CORRECTIONS SHALL APPLY AND BE A PART OF THE CONTRACT DOCUMENTS INCLUDING THE BIDDING DOCUMENTS, SPECIFICATIONS, AND DRAWINGS.

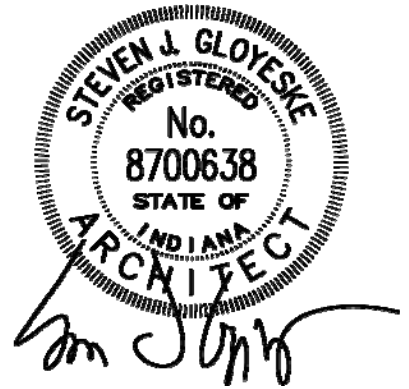

PROJECT MANUAL

SPECIFICATIONS

DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING

SECTION 23 7314 - INDOOR AIR HANDLING UNITS

1. Page 223 7314-2: At Article 2.01, add a new paragraph "M" to read as follows:
"M. McQuay."

SECTION 23 0990 - HVAC INSTRUMENTATION AND CONTROLS

1. Page 23 0900-5: At Article 2.08, delete paragraph "B" as written in its entirety and substitute the following:
"B. Hydronic system valves shall be pressure independent characterized valves that limit the flow rate to that scheduled independent of system pressure:
 - a. Body forged brass, nickel plated
 - b. Ball: chrome plated brass
 - c. Stem: chrome plated brass
 - d. Seat O-rings: Viton
 - e. Seat: fiberglass reinforced Teflon® PTFE
 - f. Characterizing disc: Brass
 - g. Packing: 2 EPDM O-rings, lubricated
 - h. Diaphragm: silicone and Nomex
 - i. Regulator components: stainless steel/brass/Delrin 500 AF
 - j. Spring: stainless steel
 - k. Body pressure rating 600 PSI
 - l. Media temp. range 0°F to 212°F
 - m. Close off pressure 200 PSI
 - n. Leakage ANSI Class IV (0.01% of rated valve capacity at 50 psi differential."

DRAWINGS

MECHANICAL

SHEET MD101 - PARTIAL HVAC DEMOLITION PLANS

1. At the 'PARTIAL THIRD FLOOR HVAC DEMOLITION PLAN', add the following note:
"REMOVE AND RELOCATE THE EXISTING PNEUMATIC THERMOSTAT IN ROOM 318 (FURTHEST ROOM TO THE EAST). REFER TO M101 FOR NEW LOCATION IN ROOM 320A."

END OF ADDENDUM